

**Models:**

GENII AI REM: Analogue Input Module

**GENII AI REM****Analogue Input Module****Overview**

The Innotech GENII AI REM Analogue Input Module is a remote expansion device for the GENESIS range of Digital Controllers.

The module is powered by 24VAC and provides 6 analogue inputs to be connected to field equipment. Each analogue input has a socket for an Analogue Input Signal Conditioner (AISC) which defines its input type and range selection. Analogue input resolution for the GENII AI REM is 14 bits.

The AISCs used are the same as those used on the GENESIS Digital Controllers.

The GENII AI REM may be located remotely from the GENESIS Digital Controller providing distributed analogue inputs for the system.

The GENII AI REM is configured and programmed via the GENESIS Digital Controller.

The GENII AI REM communicates with the Genesis Controller via the REM Comms port. The remote link uses RS485 at a baud rate of 38400. For pre-version 5 controllers, a GENII RMI Remote Module Interface is required. Please refer to DS 15.01 for further information.

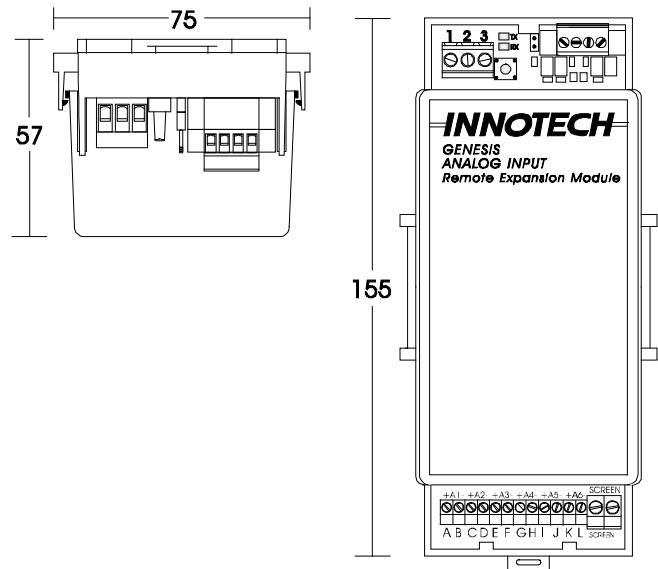
**Features**

- 6 Analogue inputs
- AISC defines input type and range selection
- Remote sensing and control of I/O points, up to 500 metres from the Genesis Controller
- Housed in a low profile din rail mounted enclosure
- RS485 interconnection between REM modules
- Galvanic Isolation for communications to prevent grounding problems
- 24VAC operation
- JUMPER selectable Address
- Wiring Diagrams for modules generated by GEN2Config Software
- LED indication of network traffic assists network setup & debugging

**Approvals**

The GENII AI REM conforms to:

- EN61326-1:2013 for CE & RCM Labelling
- Title 47 CFR, Part 15 Class A for FCC Marking
- UL listed to UL916, File Number E242628

**Applications**

- Expands GENESIS Digital Controller I/O capabilities by providing 6 Analogue Inputs allowing distributed data acquisition via RS485.

**Application Notes**

A GENESIS Controller must have Version 4 firmware installed to support REM Modules. Version 4 Config Software must be used to configure a GENESIS Digital Controller that has REM Modules connected to it.

For detailed connection information to the pre-version 5 GENESIS Digital Controller Family, please refer to the Genesis Installation Manual.

## Specifications

### Power Supply

- 24VAC ±10% @ 50/60Hz
- Power Consumption: 4VA max

The operating voltage must meet the requirements of Safety Extra Low Voltage (SELV) to EN60730. The transformer used must be a Class 2 safety transformer that has the energy and voltage limiting characteristics as described in the National Electrical Code, ANSI/NFPA70. It must also be sized and fused in compliance with local safety regulations.

### Inputs

- 6 Analogue Inputs

The Analogue Inputs require an Analogue Input Signal Conditioner (AISC) to determine the Input type (AISC's must be ordered separately).

**i** The GENII TD1, GENII D33 & GENII P20 Straps CANNOT be used with the GENII AI REM.

### Terminal Identification

1	24VAC Supply
2	0VAC Supply
3	Earth

**i** TERMINAL 3 is for the protection of the Comms circuitry and must be connected to a good electrical bonded Earth. This may be the Earth bus bar of the switchboard or the point that connects the chassis of the equipment the Module is in, to electrical Earth. This point should not be tied to terminal 2.

### COMMS Connection

SHLD 1	Shield from incoming Comms Cable
+	RS485 (+) signal
-	RS485 (-) signal
SHLD 2	Shield from outgoing Comms Cable

### I/O Terminal Connections

A	Input 1 +
B	Input 1 -
C	Input 2 +
D	Input 2 -
E	Input 3 +
F	Input 3 -
G	Input 4 +
H	Input 4 -
I	Input 5 +
J	Input 5 -
K	Input 6 +
L	Input 6 -

### Temperature Ratings

- Storage 0 to 50°C non-condensing
- Operating 0 to 40°C non-condensing

### Enclosure

The GENII REM Modules are housed in a rectangular case made from flame retardant polycarbonate / ABS plastic listed under UL94.

Colour: Grey  
Mounting: DIN Rail

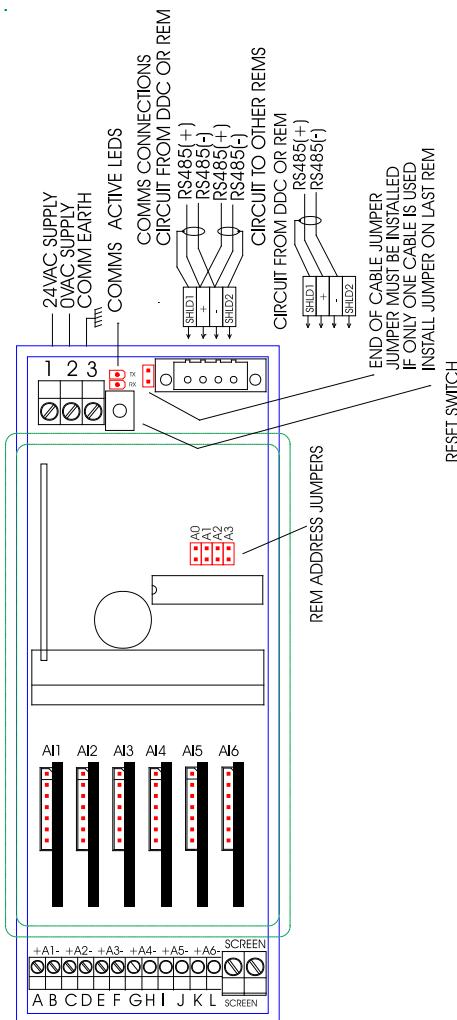
### Installation

- The cable run between the GENII AI REM and the GENII RMI should not exceed 500 metres. The Comms wiring requires cable especially suited for RS485. Other shielded cable is not suitable and may cause spasmodic Comms failures.
- Strictly follow the guidelines when installing the Comms wiring as outlined in the Genesis II Installation Manual.
- Mount the GENII AI REM in a dry and clean location free of excess vibration.
- There are four jumpers located in a row on the upper section of the GENII REM Module. These are labelled A0, A1, A2 and A3. These set the address of the GENII REM Modules. Directions for setting the address are shown in the wiring diagram generated by the GEN2Config software.

**i** If for some reason, an address for a module needs to be changed, the unit must be powered down before the jumpers are altered. Anti-static precautions should be taken when changing addresses or adding or removing cabling from the terminals.

### Wiring

- The cable used for RS485 Comms must be shielded single twisted pair, 120 ohms character impedance, 36 to 45pF per metre capacitance between conductors.
- The Comms cable must be organised as a bus topology. That is, starting at one end, devices are connected to it until the other end of the cable is reached. No "stubs" are allowed. To connect a device to the cable, a cut is made in the cable at the point where the device is to be situated along it. Then, the two new ends of the cable are wired into the device. The shields from the two new ends are then terminated into the terminals marked SHLD1 and SHLD2 respectively. Refer to the Genesis System Network Installation Instructions for more information.
- Analogue input cables should be run using twisted pair shielded cable. The shields are to be connected to terminals M, N or O.



### FCC Class A Notice

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions:

- This device may not cause harmful interference.
- This device must accept any interference received, including interference that may cause undesired operation.

Note - This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications.

Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

Modifications to this device, may void the authority granted to the user by the FCC to operate this equipment.

This page has been left intentionally blank.



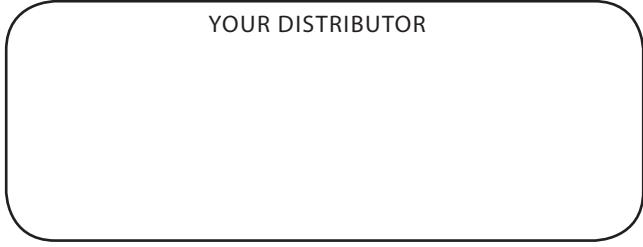
Australian Owned, Designed & Manufactured

by Mass Electronics Brisbane

**Phone:** +61 7 3421 9100   **Fax:** +61 7 3421 9101

**Email:** [sales@innotech.com.au](mailto:sales@innotech.com.au)   [www.innotech.com.au](http://www.innotech.com.au)

YOUR DISTRIBUTOR

A large, empty rectangular box with rounded corners, intended for the distributor's name or contact information.