

**Models:**

MS1-05: 1 Speed FAN, 2 COOL &amp; 2 HEAT Controller

**MS1-05****Microcontroller****Specifications****Power Supply**

Voltage: 240VAC ±10% @ 50/60Hz

Power Consumption: 7VA Max.

**Input**

10kΩ thermistor temperature sensor - 0°C to 50°C range  
Switched contact for Timeclock input  
Switched contact for After Hours operation  
Switched contact for A/C Devices Disable  
Switched contact for Heat/Cool Device Disable

**Outputs**

Relay 1 to 5 Voltage free relay contacts:  
Normally Open: - 16A resistive  
- 6A inductive

**Connection between Controller and Control Station**

5 way connection via 4 core plus screen cable

**Control Terminal Identification**

TH1 Temperature Sensor Input  
TH2 Temperature Sensor Input (10kΩ thermistor)  
SHLD Cable Shield for Temperature Sensor  
DI#n+ Digital Input - positive  
DI#n- Digital Input - negative  
P+ 12VDC to Control Station  
P- 0VDC to Control Station  
C+ RS485 Comms + to Control Station  
C- RS485 Comms - to Control Station  
SHLD Wall Panel Cable Shield

**Input Terminal Identification**

240V Power connection to Control Station:  
E Earth  
N Neutral supply  
240V Mains 240VAC Supply

**Output Relays**

NO Normally Open contact  
Com Common contact

**Temperature Ratings**

Storage: 0-50°C non-condensing  
Operating: 0-40°C non-condensing

**Enclosure**

The control is provided in three parts. The wall mounted Control Station, the Remote Controller and a Bead Type Return Air Detector.

**Control Station**

HPM or Clipsal style switchplate


Dimensions: 115mm x 72mm x 30mm

**Controller**

Plastic enclosure manufactured from an ignition resistant grade of ABS which meets the requirements of AS2420.

Colour: Grey

Dimensions: 107mm x 89mm x 69mm

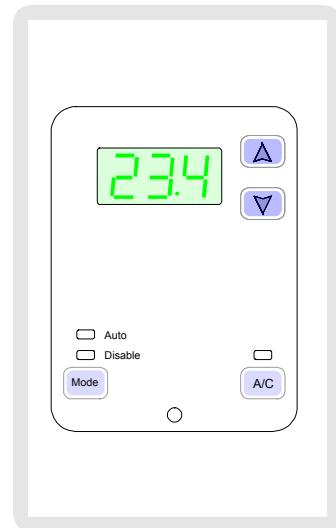**Application**

The INNOTECH Microstat Controller is designed to be used in commercial applications to provide complete control for air conditioning systems.

**Features**

- LED Display of Temperature, Set Point and Program Functions
- Control Station fits standard electrical wall plates
- Four core screened cable simplifies connection between the Control Station and Controller
- Adjustable Proportional Band, Dead Zone, Compressor Off Time and Setpoint Range
- Able to operate as 2 cool, 2 electric heating or as reverse cycle heating or cooling
- Remote disable, Timeclock Override, After Hours functions and Heat/Cool disable functions.
- Display auto-dims when the lights are out
- Configurable Power On settings
- All adjustments are made from the Control Station

## Installation

1. Mount in a dry and reasonable clean location free of excessive vibration.
2. Wire in accordance with INNOTECH connection diagrams and local bylaws or refer to your local distributor.

 This product should only be installed by qualified personnel.

## Wiring

1. Connect 240VAC supply to the correct terminals on the controller, observing the correct polarity of the connections.
2. Connect the EARTH to the correct terminals on all units.
3. DO NOT connect 240VAC to the control terminals.
4. Ensure that the wiring between the control station and the controller is correctly connected. Failure to do so will result in malfunctioning and may damage either or both units.
5. The maximum wire length between the control station and controller should not exceed 50 metres. The wiring between these devices should not be run in parallel with conductors carrying high current.

## Digital Inputs

### DI1 Timeclock

The Microcontroller is equipped with a remote timeclock enable function.

When the time clock input (DI1) is "ON", the Microcontroller will run in A/C mode.

### DI2 After Hours

The Microcontroller is equipped with an After Hours timer.

When a pulse is received on the After Hours input (DI2), the unit will run in A/C mode for the period set in Program Parameter 7.

If a pulse is received while the Microcontroller is in After Hours mode, it will toggle off.

### DI3 Unit Disable

The Microcontroller is equipped with an AC unit disable function.

If the disable input (DI3) is "ON" for the period set in Program Parameter 8, the Microcontroller will shut down the Air Conditioning unit. When the Microcontroller is disabled, the A/C LED will flash to indicate that the Microcontroller is being overridden.

When the remove disable input is opened, the unit can be restarted by pressing the ON/OFF button.

### DI4 Device Disable

The Microcontroller is equipped with a Heat/Cool disable.

If the remote disable input (DI4) is "ON" for the period set in Parameter A, the Microcontroller will shut down the specified A/C devices (Heat only, Cool only or Heat and Cool) as indicated in Parameter 9.

When the input is turned off, the unit will restart the A/C devices as required.

## Adjustable Parameters

### Jumper Settings on the Control Station

#### Jumper #1 (JP1 Rev)

This jumper is used to select Electric Heat or Reverse Cycle operation.

When the link is open, the heat and cool relays operate independently of each other.

When the link is closed, the cool relay controls the compressor in both cooling and heating operations. The heat relay operates the reversing valve.

#### Jumper #2 (JP2 H/C)

This jumper is used to select if the reversing valve is energised for cooling or energised for heating.

When the link is open, the heat relay will close during cooling.

When the link is closed, the heat relay will close during heating.

 This function is only effective if Jumper #1 is set for Reverse Cycle operation.

#### Jumper #3 (JP3 Fan)

This jumper is used to select continuous fan operation or fan cycles with heating.

When the link is closed, the fan runs continuously on cooling and cycles with heating.

 Jumper settings will not take effect until supply power is reset to the controller.

## Digital Display

The digital display will show the following error codes to assist with fault finding.

- Display Reads "99.9"  
This indicates either a faulty sensor or faulty sensor cabling.
- Display Reads "HLP"  
This indicates that communication between the Control Station and Controller is not operating.

First check the interconnecting cabling and if this is OK, contact your local Innotech Distributor.

## Program Functions on the Control Station

All variable settings for the Microcontroller are adjusted at the Control Station.

### Programming Mode

To enter Programming Mode, depress and hold the  and  buttons for 5 seconds. The display will become blank indicating that you are in the Programming Mode. Release both keys and the display will show parameter 0.

While in the programming mode, the following buttons are active:

 Change to the next parameter

 Increase the current parameter value

 Decrease the current parameter value

To Exit the Programming Mode, depress the  and  buttons and the new setting will be saved.

### Parameter 0 - Sensor Calibration

The Display will show the sensor temperature. To offset the sensor temperature, adjust using  the or  buttons.

- The range of the Offset is  $\pm 9.9^{\circ}\text{C}$
- The factory default setting is  $0.0^{\circ}\text{C}$

### Parameter 1 - Minimum Setpoint

The display will show the Minimum Setpoint to which the controller can be set.

- The range of the Minimum Setpoint is 0 to  $99^{\circ}\text{C}$
- The factory default setting is  $15^{\circ}\text{C}$

### Parameter 2 - Maximum Setpoint

The display will show the Maximum Setpoint to which the controller can be set.

- The range of the Maximum Setpoint is 0 to  $99^{\circ}\text{C}$
- The factory default setting is  $30^{\circ}\text{C}$

### Parameter 3 - Dead Band

The display will show the Dead Band setting.

- The range of the Dead Band is 0 to  $9.9^{\circ}\text{C}$
- The factory default is  $1.0^{\circ}\text{C}$

### Parameter 4 - Proportional Band

The display will show the Proportional Band (PB) setting. A PB setting of  $2^{\circ}\text{C}$  will result in a differential of  $2^{\circ}\text{C}$  for heating and  $2^{\circ}\text{C}$  for cooling.

- The range of the Proportional Band is 0 to  $9.9^{\circ}\text{C}$
- The factory default is  $1.0^{\circ}\text{C}$

### Parameter 5 - Compressor Minimum Off Time

The display will show the Compressor Minimum Off Time.

This is the period the compressor must remain off before it can restart.

- The range of the Off Time is 0 to 99 minutes
- The factory default is 4 minutes

### Parameter 6 - Fan Run On Time

The display will show the Fan Run On Time.

This is the period that fan will run for if it is operating in heating mode and the controller is turned off. This is to remove any residual heat where electric heating is used.

- The range of the Run On Time is 0 to 99 seconds.
- The factory default setting is 30 seconds.

### Parameter 7 - After Hours Timer

The display will show the After Hours Time.

This is the period the unit will run for if an After Hours pulse is received.

- The range of the After Hours Time is 0 to 9.9 hours.
- The factory default setting is 1 hour.

### Parameter 8 - Remote AC Unit Disable Timer

The display will show the Remote Disable Time.

This is the time that the controller must see the Remote Disable input for before it turns off.

- The range of the Disable Timer is 0 to 99 minutes.
- The factory default setting is 1 minute.

### Parameter 9 - Devices Disable

The display will show 7 settings of device disable.

### Configurations for Device Disable

Parameter	Disable Heating	Disable Cooling	Show "Flt"
0	No	No	No
1	Yes	No	No
2	No	Yes	No
3	Yes	Yes	No
4	No	No	Yes
5	Yes	No	Yes
6	No	Yes	Yes
7	Yes	Yes	Yes

The factory default setting is 7- Heat and Cool.

 Extra functionality has been added to the Device Disable digital input handling. A fault message "FLT" is shown if this input becomes active. This will remain displayed until the fault input is removed.

### Parameter A - Device Disable Timer

The display will show the Remote Device Disable Time. This is the time that the controller must see the remote device disable input for before it turns off the specified devices.

- The range of the Device Disable Timer is 0 to 99 seconds.
- The factory default setting is 0 seconds.

### Start Up Default Settings

The Microcontroller can be set to start in any mode of operation.

To set the start up default, adjust the Microcontroller to the desired settings and then press and hold the  and  buttons for 5 seconds.

The display will become blank indicating that the new settings are saved.

### Factory Set Default Settings

Setpoint 22°C (0.0 to 99.9°C)  
Operating Mode Off (Off / On)


### Mode Function

The  button will toggle between Auto and Disable mode.

In Auto mode, the controller can be started or stopped with the  button or the Timeclock and After Hours inputs.

In Disable mode, the controller will remain off regardless of the  button status or the Timeclock and After Hours inputs.

## STANDARD CONNECTION CONTROLLER

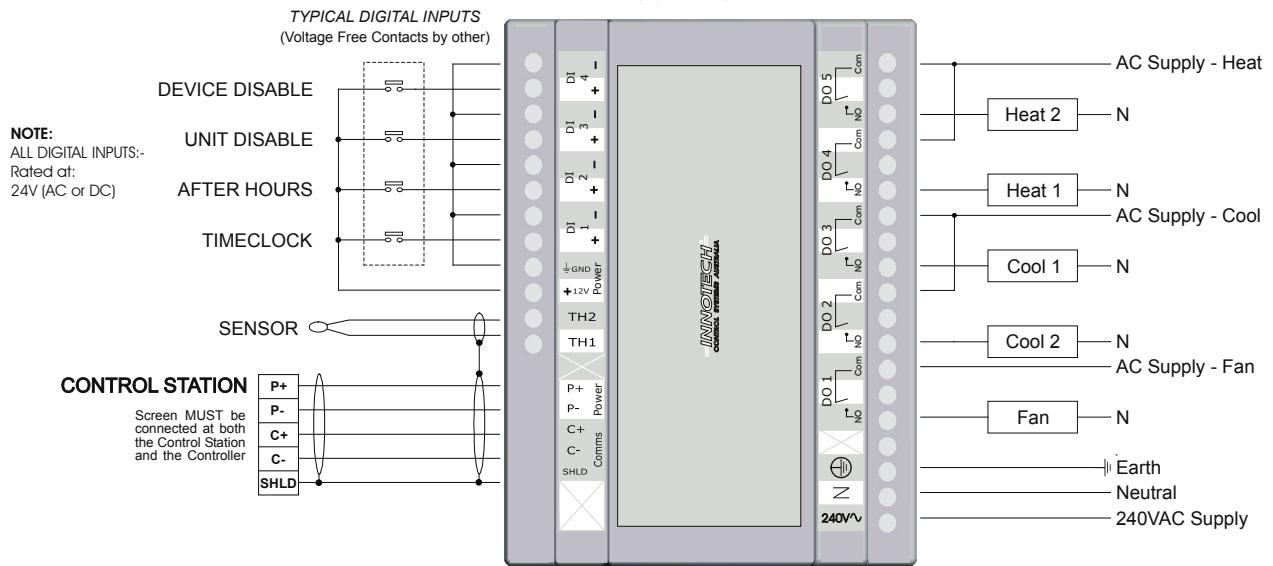


NOTE : "Com" = COMMON  
 "NO" = NORMALLY OPEN CONTACTS

\* OPEN JUMPER 1 ON THE CONTROL STATION. (JP1 REV)

\* Note if no Time Clock is used a Link must be made between +12V & DI1+ and between GND & DI1-.

\* MAXIMUM CABLE LENGTH BETWEEN THE CONTROL STATION & CONTROLLER IS 50 METRES.

## REVERSE CYCLE CONNECTION CONTROLLER

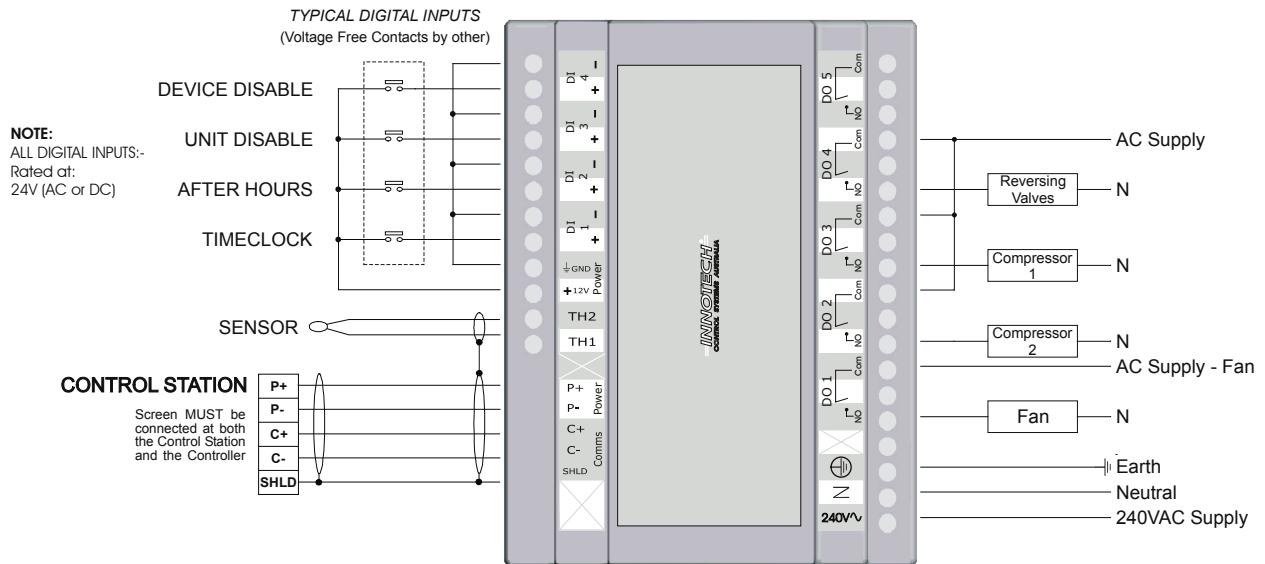

NOTE : "Com" = COMMON  
 "NO" = NORMALLY OPEN CONTACTS

\* CLOSE JUMPER 1 ON THE CONTROL STATION (JP1 REV).

\* IN THIS MODE RELAYS 4 & 5 ENERGISE TOGETHER.

\* Note if no Time Clock is used a Link must be made between +12V & DI1+ and between GND & DI1-.


\* MAXIMUM CABLE LENGTH BETWEEN THE CONTROL STATION & CONTROLLER IS 50 METRES.

This page has been left intentionally blank.



Australian Owned, Designed & Manufactured  
by Mass Electronics Brisbane  
**Phone:** +61 7 3421 9100   **Fax:** +61 7 3421 9101  
**Email:** [sales@innotech.com.au](mailto:sales@innotech.com.au)   [www.innotech.com.au](http://www.innotech.com.au)

YOUR DISTRIBUTOR

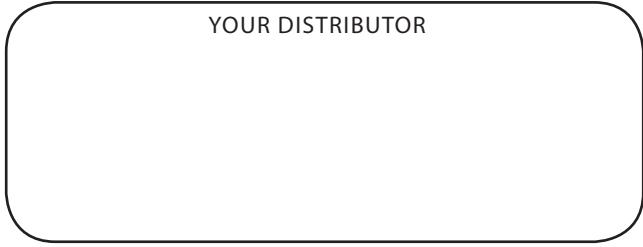A large, empty rectangular box with rounded corners, intended for the distributor's name or contact information.